



■ Features :


- Universal AC input / Full range(up to 295VAC)
- Built in active PFC compliance to EN61000-3-2 class C
- Constant Voltage design
- High efficiency up to 93%
- Protections: Short circuit / Overload / Over voltage / Over temperature
- Cooling by free air convection
- Half encapsulated
- U-bracket low profile:33mm
- ZVS technology to reduce power dissipation
- Suitable for built-in type LED applications
- 3 years warranty

SPECIFICATION



MODEL		ULP-150-12	ULP-150-15	ULP-150-24	ULP-150-36	ULP-150-48	
ОИТРИТ	DC VOLTAGE	12V	15V	24V	36V	48V	
	RATED CURRENT	12.5A	10A	6.3A	4.2A	3.2A	
	CURRENT RANGE	0 ~ 12.5A	0 ~ 10A	0 ~ 6.3A	0~4.2A	0~3.2A	
	RATED POWER	150W	150W	151.2W	151.2W	153.6W	
	RIPPLE & NOISE (max.) Note.2		150mVp-p	150mVp-p	250mVp-p	250mVp-p	
	VOLTAGE ADJ. RANGE	11.0~13.2V	13.5~16.5V	21.6~26.4V	32.4~39.6V	43.2~52.8V	
	VOLTAGE TOLERANCE Note.3	±2.0%	±2.0%	±2.0%	±2.0%	±2.0%	
	LINE REGULATION	±0.5%	±0.5%	±0.5%	±0.5%	±0.5%	
	LOAD REGULATION	±1.0%	±1.0%	±1.0%	±1.0%	±1.0%	
	SETUP, RISE TIME	500ms, 100ms/230VAC 3000ms, 100ms/115VAC at full load					
	HOLD UP TIME (Typ.)	16ms/230VAC 16ms/115VAC at full load					
INPUT	VOLTAGE RANGE Note.4	90 ~ 295VAC 127 ~ 417VDC					
	FREQUENCYRANGE	47 ~ 63Hz					
	POWER FACTOR (Typ.)	PF>0.98/115VAC PF>0.96/230VAC PF>0.94/277VAC at full load					
	TOTAL HARMONIC DISTORTION	THD< 20% when output loading≧60% at 115VAC/230VAC input and output loading≧75% at 277VAC input					
	EFFICIENCY (Typ.)	91.5%	91.5%	93%	93%	93%	
	AC CURRENT (Typ.)	2A/115VAC 1A/230V		3070	3070	3070	
	INRUSH CURRENT (Typ.)	COLD START 65A(twidth=460µs measured at 50% Ipeak) at 230VAC					
	MAX. No. of PSUs on 16A	4 units (circuit breaker of type B) / 6 units (circuit breaker of type C) at 230VAC					
	CIRCUIT BREAKER						
	LEAKAGE CURRENT	<0.75mA/277VAC					
PROTECTION		130~185% rated output power					
	OVERLOAD	Protection type: Hiccup mode, recovers automatically after fault condition is removed					
	SHORT CIRCUIT	Protection type: Hiccup mode, recovers automatically after fault condition is removed					
	OVER VOLTAGE	13.6 ~ 16.3V	17 ~ 21V	26.7 ~ 32.4V	41.4 ~ 48.6V	53 ~ 64.8V	
		Protection type : Shut down o/p voltage with auto-recovery or re-power on to recovery					
	OVER TEMPERATURE	Shut down o/p voltage, recovers automatically after temperature goes down					
ENVIRONMENT	WORKING TEMP.	-30 ~ +70℃ (Refer to "Derating Curve")					
	WORKING HUMIDITY	20 ~ 90% RH non-condensing					
	STORAGE TEMP., HUMIDITY	-40 ~ +85°C, 10 ~ 95% RH					
	TEMP. COEFFICIENT	±0.03%°C (0~60°C)					
	VIBRATION	10 ~ 500Hz, 5G 10min./1cycle, 60min. each along X, Y, Z axes					
	SAFETY STANDARDS	EAC TP TC 004 approved; Design refer to EN61347-2-13,IEC61347-2-13,UL8750					
SAFETY & EMC (Note 5)	WITHSTAND VOLTAGE Note.6	I/P-O/P:3.75KVAC I/P-FG:2KVAC O/P-FG:0.5KVAC					
	ISOLATION RESISTANCE	I/P-O/P, I/P-FG; 100M Ohms/500VDC/25°C/ 70%RH					
	EMC EMISSION	Compliance to EN55015, EN61000-3-2 Class C(≥60% load), EN61000-3-3, EAC TP TC 020					
	EMC IMMUNITY	Compliance to EN61000-4-2,3,4,5,6,8,11; EN61547, EN55024, light industry level (surge 4KV), criteria A, EAC TP TC 020					
	MTBF	216.3K hrs min. MIL-HDBK-217F (25°C)					
OTHERS	DIMENSION	215*67.4*33mm (L*W*H)					
	PACKING	0.67kg; 24PCS/17.5kg/0.65CUFT					
NOTE		eters NOT specially mentioned are measured at 230VAC input, rated load and 25°C of ambient temperature.					
NOTE	Ripple & noise are measure Tolerance: includes set up Derating may be needed ur The power supply is considia a 360mm*360mm metal plaperform these EMC tests, p Please remove the compon To fulfill requirements of the	in parameters NOT specially mentioned are measured at 230 AC input, rated load and 25 C of ambient temperature, input & 10 specially mentioned are measured at 250 Mention and load regulation. olerance: includes set up tolerance, line regulation and load regulation. erating may be needed under low input voltages. Please check the static characteristics for more details. he power supply is considered a component which will be installed into a final equipment. All the EMC tests are been executed by mounting the unit of 360mm*360mm metal plate with 1mm of thickness. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how erform these EMC tests, please refer to "EMI testing of component power supplies." (as available on http://www.meanwell.com) lease remove the component D1 before conducted Hipot test. of fulfill requirements of the latest ErP regulation for lighting fixtures, this LED power supply can only be used behind a switch without permanently onnected to the mains.					



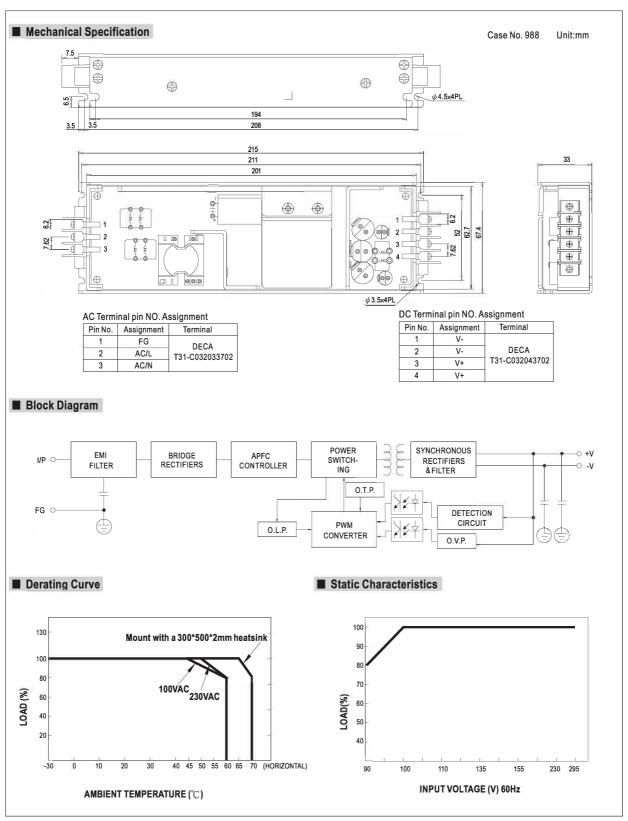

File Name:ULP-150-SPEC 2018-01-09